



**Sede : via Divisione Cuneense, 48
12010 San Rocco di Bernezzo (CN)
TEL. +39 (0)171-85404 / +39 (0)171-85112
FAX +39 (0)171-687314
P.IVA e C.F. 03019130040
e-mail : info@baggi-lux.com
sito: www.baggiluxtecnica.com**



RILEVATORE DI CALORE PER LIP

SCHEDA TECNICA




RILEVATORE DI CALORE LIP

Il rilevatore/sonda 75°,110°,140°C, va inserito all' interno della LIP ed è in grado di rilevare la temperatura in prossimità dell' E.N.F.C. "SunSmoke 2000V-EVO ELETTRICO", e di inviare un' impulso alla centrale per poterlo fare aprire.

Installation Guide for Heat Detector in LIP7
Installationsanleitung für Wärmemelder in LIP7
Monteringsvejledning for varmedetektor i LIP7

Dipswitch no. 3 set to OFF
Dipschalter Nr. 3 auf OFF gesetzt
Dipswitch nr. 3 sættes til OFF

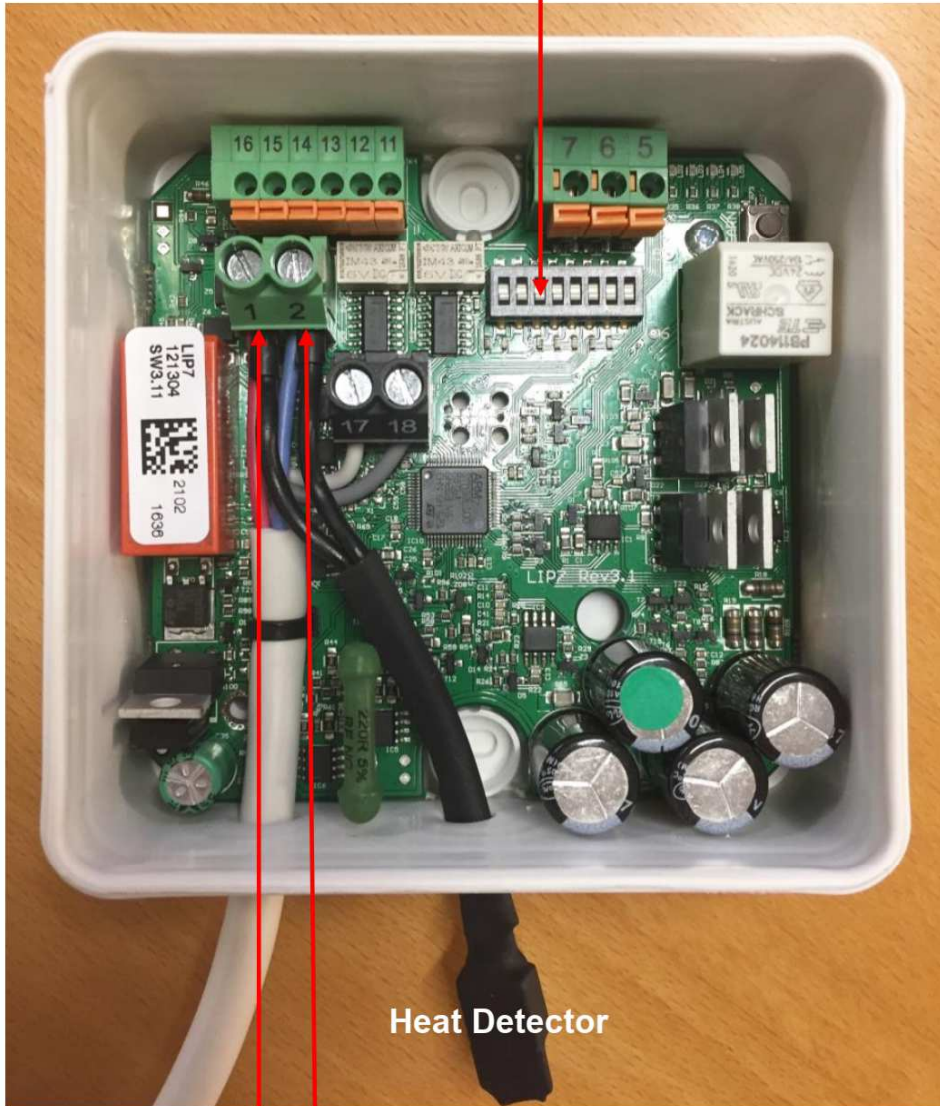

Heat Detector

Heat Detector installed in Terminal 1 and 2
Wärmemelder in Terminal 1 und 2 installiert
Varmedetektoren monteres i klemme 1 og 2



**Construction Products Regulation:
305/2011**

DECLARATION OF PERFORMANCE

No. 0832-CPR-F1445

1. Unique identification code of the product-type:

**55000-122
Variant:
55000-122LIM**

2. Type, batch or serial number or any other element allowing identification of the construction product as required under Article 11(4) of the CPR:

**55000-122 Series 65 Conventional Class A1R Heat Detector
Variant:
55000-122LIM Series 65 Conventional Class A1R Heat Detector**

**To be used in conjunction with the following bases: 45681-200,45681-201,45681-245,
45681-246,45681-247,45681-248**

Each individual product is identified with a label containing a production date code with build standard number

3. Intended use or uses of the construction product, in accordance with the applicable harmonized technical specification, as foreseen by the manufacturer:

Fire detection and fire alarm systems

4. Name, registered trade name or registered trade mark and contact address of the manufacturer as required under Article 11(5):

**Apollo Fire Detectors Ltd,
36 Brookside Road, Havant, Hampshire, PO9 1JR**

5. Where applicable, name and contact address of the authorised representative whose mandate covers the tasks specified in Article 12(2):

**Apollo Fire Detectors Ltd,
36 Brookside Road, Havant, Hampshire, PO9 1JR**

6. System or systems of assessment and verification of constancy of performance of the construction product as set out in CPR, Annex V:

System 1

7. In case of the declaration of performance concerning a construction product covered by a harmonized standard:

BRE Global Limited (Notified Body 0832) has performed type testing of the product, initial inspection of the manufacturing plant and of factory production control with continuous surveillance, assessment and evaluation of factory production control under system 1 and issued the following Certificate of Constancy of Performance:

0832-CPR-F1445

[x1]

A HALMA COMPANY



Assessed to ISO 9001:2008
LPCB Cert No. 110



Certificate No. 311
See www.halma.com/ukas



Assessed to ISO 14001:2004
Certificate number 1948 515

Apollo Fire Detectors Limited

36 Brookside Road, Havant, Hampshire, PO9 1JR, UK
t +44 (0)23 9249 2412 f +44 (0)23 9249 2754 e sales@apollo-fire.co.uk

www.apollo-fire.co.uk

Apollo Fire Detectors Ltd. Registered in England No. 1483209
Registered Office: 36 Brookside Road, Havant, Hampshire, PO9 1JR VAT Registration No. GB339 055354

8. In case of the declaration of performance concerning a construction product for which a European Technical Assessment has been issued:

Not applicable

9. Declared performance:

10. Essential Characteristics	Standard EN 54-5: 2000 + A1:2002	Performance
Nominal activation conditions/Sensitivity, Response delay (response time) and Performance under fire conditions	4.2, 4.3, 5.2 to 5.6,5.8,6.1,6.2	Pass
Operational reliability	4.4 to 4.11	Pass
Tolerance to supply voltage	5.7	Pass
Durability of operational reliability and response delay: temperature resistance	5.9,5.10	Pass
Durability of operational reliability: vibration resistance	5.14 to 5.17	Pass
Durability of operational reliability: humidity resistance	5.11, 5.12	Pass
Durability of operational reliability: corrosion resistance	5.13	Pass
Durability of operational reliability: electrical resistance	5.18	Pass

The performance of the product identified above is in conformity with the performance and essential characteristics declared within this certificate. The declaration of performance is issued under the sole responsibility of Apollo Fire Detectors Limited.

Signed for and on behalf of Apollo Fire Detectors Limited by:



Mr. Karl Westhead
Technical Director

Place and Date of Issue: Havant - **17 January 2017**